

- ▶ Base device for Emergency Stop, Safety Gate and Light Grid applications
- ▶ Equivalent or non-equivalent activation selectable
- ▶ Two-channel activation including Cross Monitoring and Synchronous Time Check
- ▶ Automatic or Manual Star
- ▶ 3 enabling current paths
- ▶ For applications up to safety category 4
- ▶ Stop category 0
- ▶ Width 22.5mm
- ▶ Industrial design



Technical data

1. Functions

Two-channel safety switching device with self-monitoring on each ON-OFF cycle. Monitoring of safety actuators for generating a safety-oriented output signal (enable) via forced output relay contacts.

2. Indicators

Green LED U ON:	indication of supply voltage
Green LED K1 ON/OFF:	safety channel 1 enabled
Green LED K2 ON/OFF:	safety channel 2 enabled

3. Mechanical design

Self-extinguishing plastic housing, IP rating IP40
 Mounted on DIN-Rail TS 35 according to EN 50022
 Mounting position: any
 Shockproof terminal connection according to VBG 4, IP rating IP20
 Tightening torque: 0.5 to 0.6Nm
 Terminal capacity:
 2 x 0.14 to 0.75mm² without multicore cable end
 1 x 0.14 to 2.5mm² without multicore cable end
 2 x 0.25 to 0.5mm² flexible with multicore cable ends
 1 x 0.25 to 2.5mm² flexible with multicore cable ends

4. Input circuit

Supply voltage:	24V AC/DC	terminals A1-A2
Tolerance:	24V AC/DC	-15% to +10%
Rated frequency:		50 to 60Hz
Rated consumption:	24V AC/DC	4.4VA (2.4W)
Duration of operation:		100%
Residual ripple bei DC:		2.4Vss

5. Output circuit

3 forced normally open contacts (enabling current paths)
 Rated voltage: 230V AC / 300V DC
 Rated current of enabling paths: max. 6A
 Fusing: gG 6A (MCB 6 B or C)
 Total current of all paths: max. 12A
 Mechanical life: 10 x 10⁶ operations
 Switching capacity (according to IEC 947-5-1):
 max. 6/min (AC-15: 4A/230V AC)
 max. 60/min (AC-15: 3A/230V AC)
 max. 6/min (DC-13: 4A/24V DC)
 max. 60/min (DC-13: 2.5A/24V DC)
 Insulation voltage: 300V AC (according to IEC 664-1)
 Surge voltage: 4kV, overvoltage category III (according to IEC 664-1)
 Release time t_R (K1, K2): 25ms

6. Safety circuit

Function:	Connection of safety switching-devices (e.g. E-stop) or semiconductor output of safety actuator (OSSD)
Rated voltage:	22V DC
Input voltage range for semiconductor drive	
high:	17.4V to 26.4V DC
low:	-3.0V to +5V DC
Test pulse time (t _p):	≤1ms, max. 10/s
Rated current:	40mA
Peak current:	100mA
Short circuit protection:	short-circuit proof
Response time:	-
Reset time:	-
Safety channel 1 (CH1):	terminals S11-S12
Safety channel 2 (CH2)	
cross monitoring:	terminals S21-S22 (bridge S11-S31)
without cross monitoring:	terminals S11-S31 (bridge S21-S22)
Synchronous time (CH1 before CH2):	approx. 200ms
Synchronous time (CH2 before CH1):	∞
Input debouncing:	No
Galvanic separation to power supply:	No

7. Reset circuit

Function:	
manual monitored reset:	potential free normally open contact, terminals S33-S34
automatic start:	bridge at terminals S33-S35
Rated voltage:	22V DC
Rated current:	5mA
Peak current:	50mA
Short circuit protection:	short-circuit proof
Response time (K1, K2)	
manual monitored start (t _{A1}):	max. 40ms
automatic start (t _{A2}):	max. 600ms
Pulse length t _M :	min. 80ms
Galvanic separation to power supply:	No

8. Ambient conditions

Ambient temperature:	-25 to +55°C (according to IEC 68-1)
Storage temperature:	-25 to +75°C
Transport temperature:	-25 to +75°C
Relative Humidity:	max. 83% (bei 23°C), max. 93% (bei 40°C) nach DIN 50016
Pollution degree:	3 outside, 2 inside (according to IEC 664-1)

Functions

Two-channel E-stop with Cross Monitoring and Manual Start with Reset Monitoring.

With the supply voltage connected to terminals A1-A2 (green LED U illuminated) and not actuated E-stop switch (terminals S21-S22 and S11-S12 closed) the output relays pick up within the response time t_{A1} (green LED K1 and K2 illuminated), as soon as the reset button at terminals S33-S34 is closed and opened again (Manual Start with Reset Monitoring).

If the E-stop switch is activated, the output relays release within the release time t_{R1} (terminals 13-14, 23-24 and 33-34 open) and the enabling current paths are interrupted.


If the supply voltage fails, the output relays release within the release time t_{R2} .

A restart of the safety relay can only be provided, after the E-stop switch has been unlocked again.

If in case of a fault only one of the two safety channels is opened, the output relays release and get locked until both safety channels have been opened and closed again.

If a short circuit to ground or an interwire short circuit occurs, the cross monitoring function deactivates the output relays within the release time.

A restart of the safety relay can only be provided, if the short circuit has been removed.

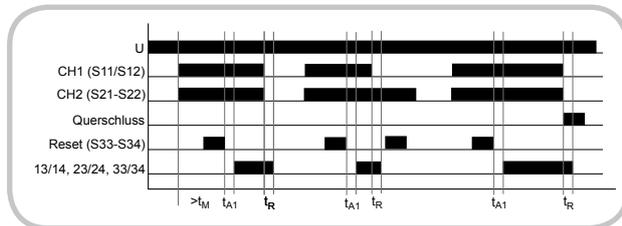

Two-channel E-stop without Cross Monitoring with manual monitored start


The function is equal to two-channel E-stop with cross monitoring, but interwire short circuits between the safety channels are not monitored.

Two-channel Safety Gate Monitoring with Cross Monitoring and Automatic Start




If the supply voltage applies at terminals A1-A2 (LED U illuminated), the bridge at terminals S33-S35 provides an automatic start of the safety relay as soon as contacts S1 (terminals S11-S12) and S2 (terminals S21-S22) are closed.

If the contacts are positioned in a way, that S1 gets closed before S2, synchronism of the activation is monitored. In this case the output relays (K1, K2) only pick up, if contacts S1 and S2 get activated within the synchronous time. If S2 is closed before S1 synchronism is not monitored.

If a short circuit to ground or an interwire short circuit is monitored, the Cross Monitoring function deenergizes the output relays and the enabling current paths are opened within the release time t_{R1} . A reset of the safety relay can only be executed, if the short circuit has been removed.

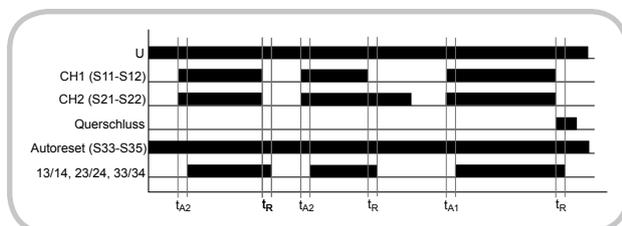

Connections

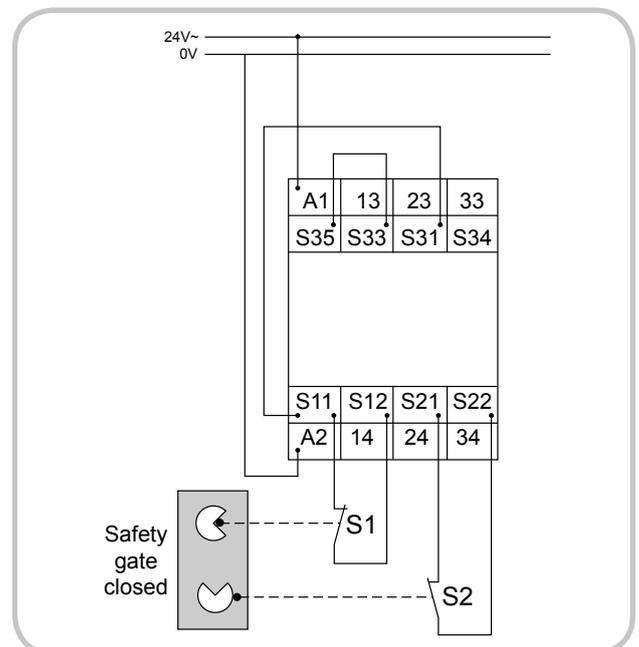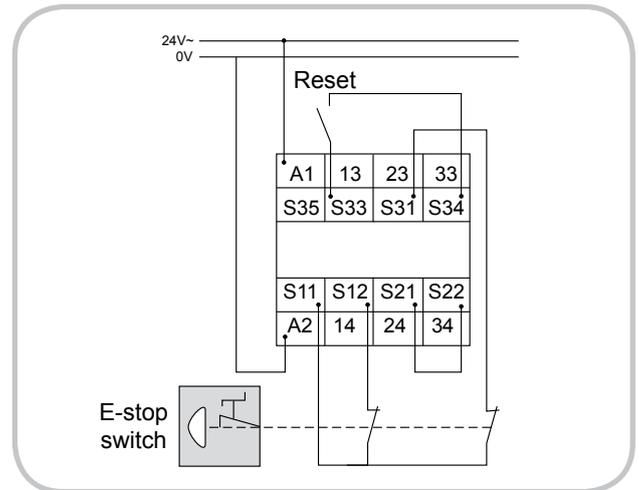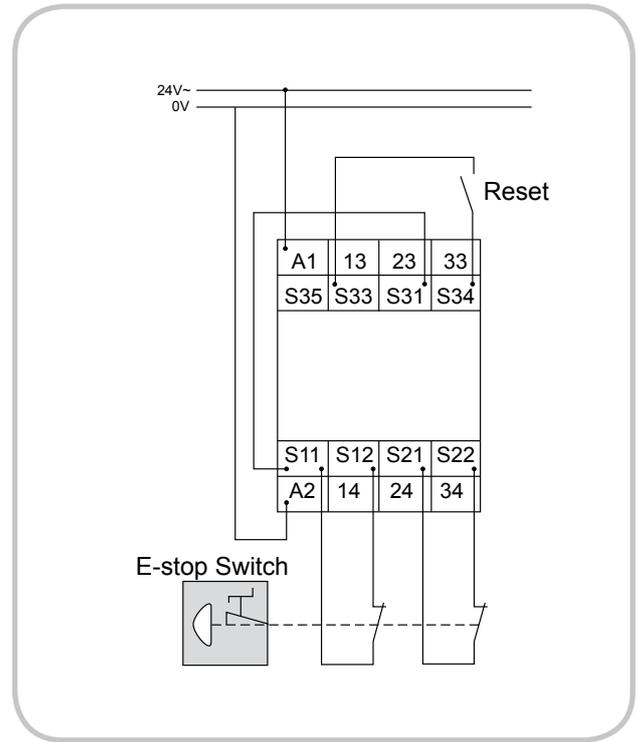


Functions


Monitoring safety switching devices with semiconductor output (OSSD)

With the supply voltage connected to terminals A1-A2 (green LED U illuminated), the output relays K1 and K2 pick up, as soon as a high signal is connected to safety channel 1 and 2 (terminals S12, S31). If signaling voltage is connected to S12 first, synchronism of activation is monitored. In that case the signaling voltage has to be applied to S31 within the synchronous time t_s to activate the output relays K1 and K2.


If at least one of the safety channels is deenergized longer than the maximum permissible test pulse time t_{TP} , the output relays release within the release time t_{R1} . A restart of the safety relay is disabled until both safety channels have been deenergized.

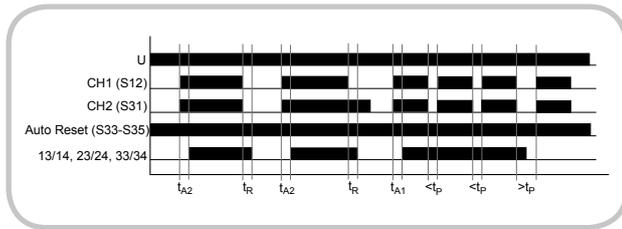


Internal circuitry

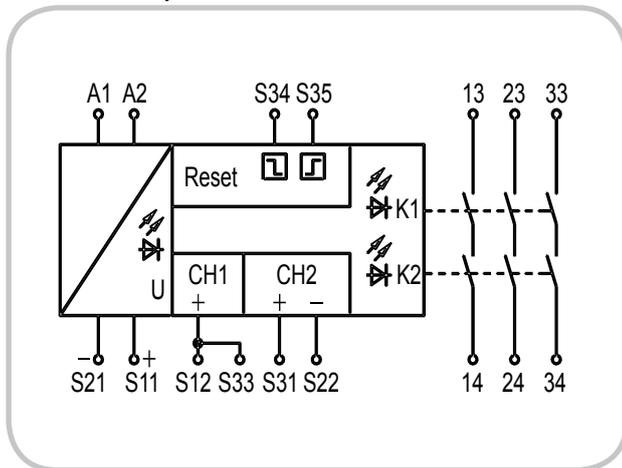

Connections

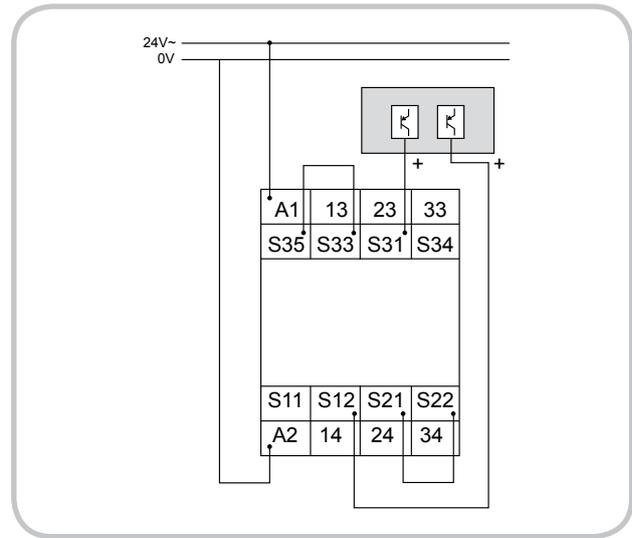

Dimensions

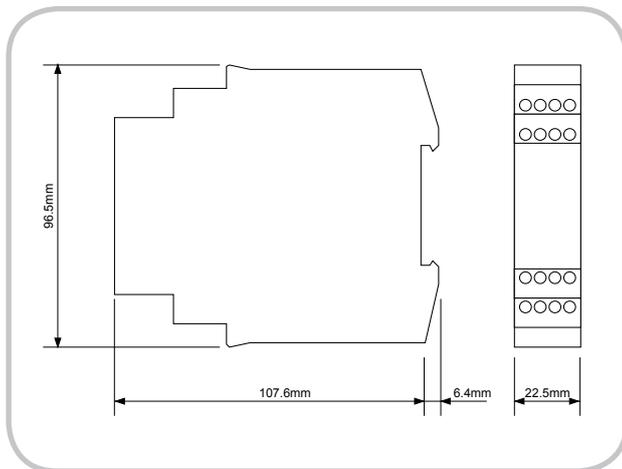

Subject to alterations and errors